


DO NOT SCALE FROM THIS DRAWING. USE FIGURED DIMENSIONS IN ALL CASES. VERIFY DIMENSIONS ON SITE AND REPORT ANY DISCREPANCIES TO THE DESIGNERS IMMEDIATELY.  
THIS DRAWING TO BE READ IN CONJUNCTION WITH THE DESIGNERS SPECIFICATION.  
© THIS DRAWING IS COPYRIGHT AND MAY ONLY BE REPRODUCED WITH THE DESIGNERS PERMISSION.

- NOTE:
- ALL CONSTRUCTION PRODUCTS COVERED BY A HARMONIZED EUROPEAN PRODUCT STANDARD SHALL HAVE DECLARATION OF PERFORMANCE AND A CE MARK IN COMPLIANCE WITH THE CONSTRUCTION PRODUCT REGULATION (EU) NO. 305/2011 CPR.
  - ALL EXTERNAL STEELWORK GALVANISED TO IS EN ISO 1461.
  - ALL COVERS, GRATINGS & FRAMES IN HARDSTANDING AREAS ARE TO BE A MINIMUM OF CLASS D400 DUCTILE IRON IN ACCORDANCE WITH BS EN 124
  - ALL WORK TO BE IN ACCORDANCE WITH EIRGRID FUNCTIONAL SPEC DOCUMENT: - XDS-GFS-13-001-R2

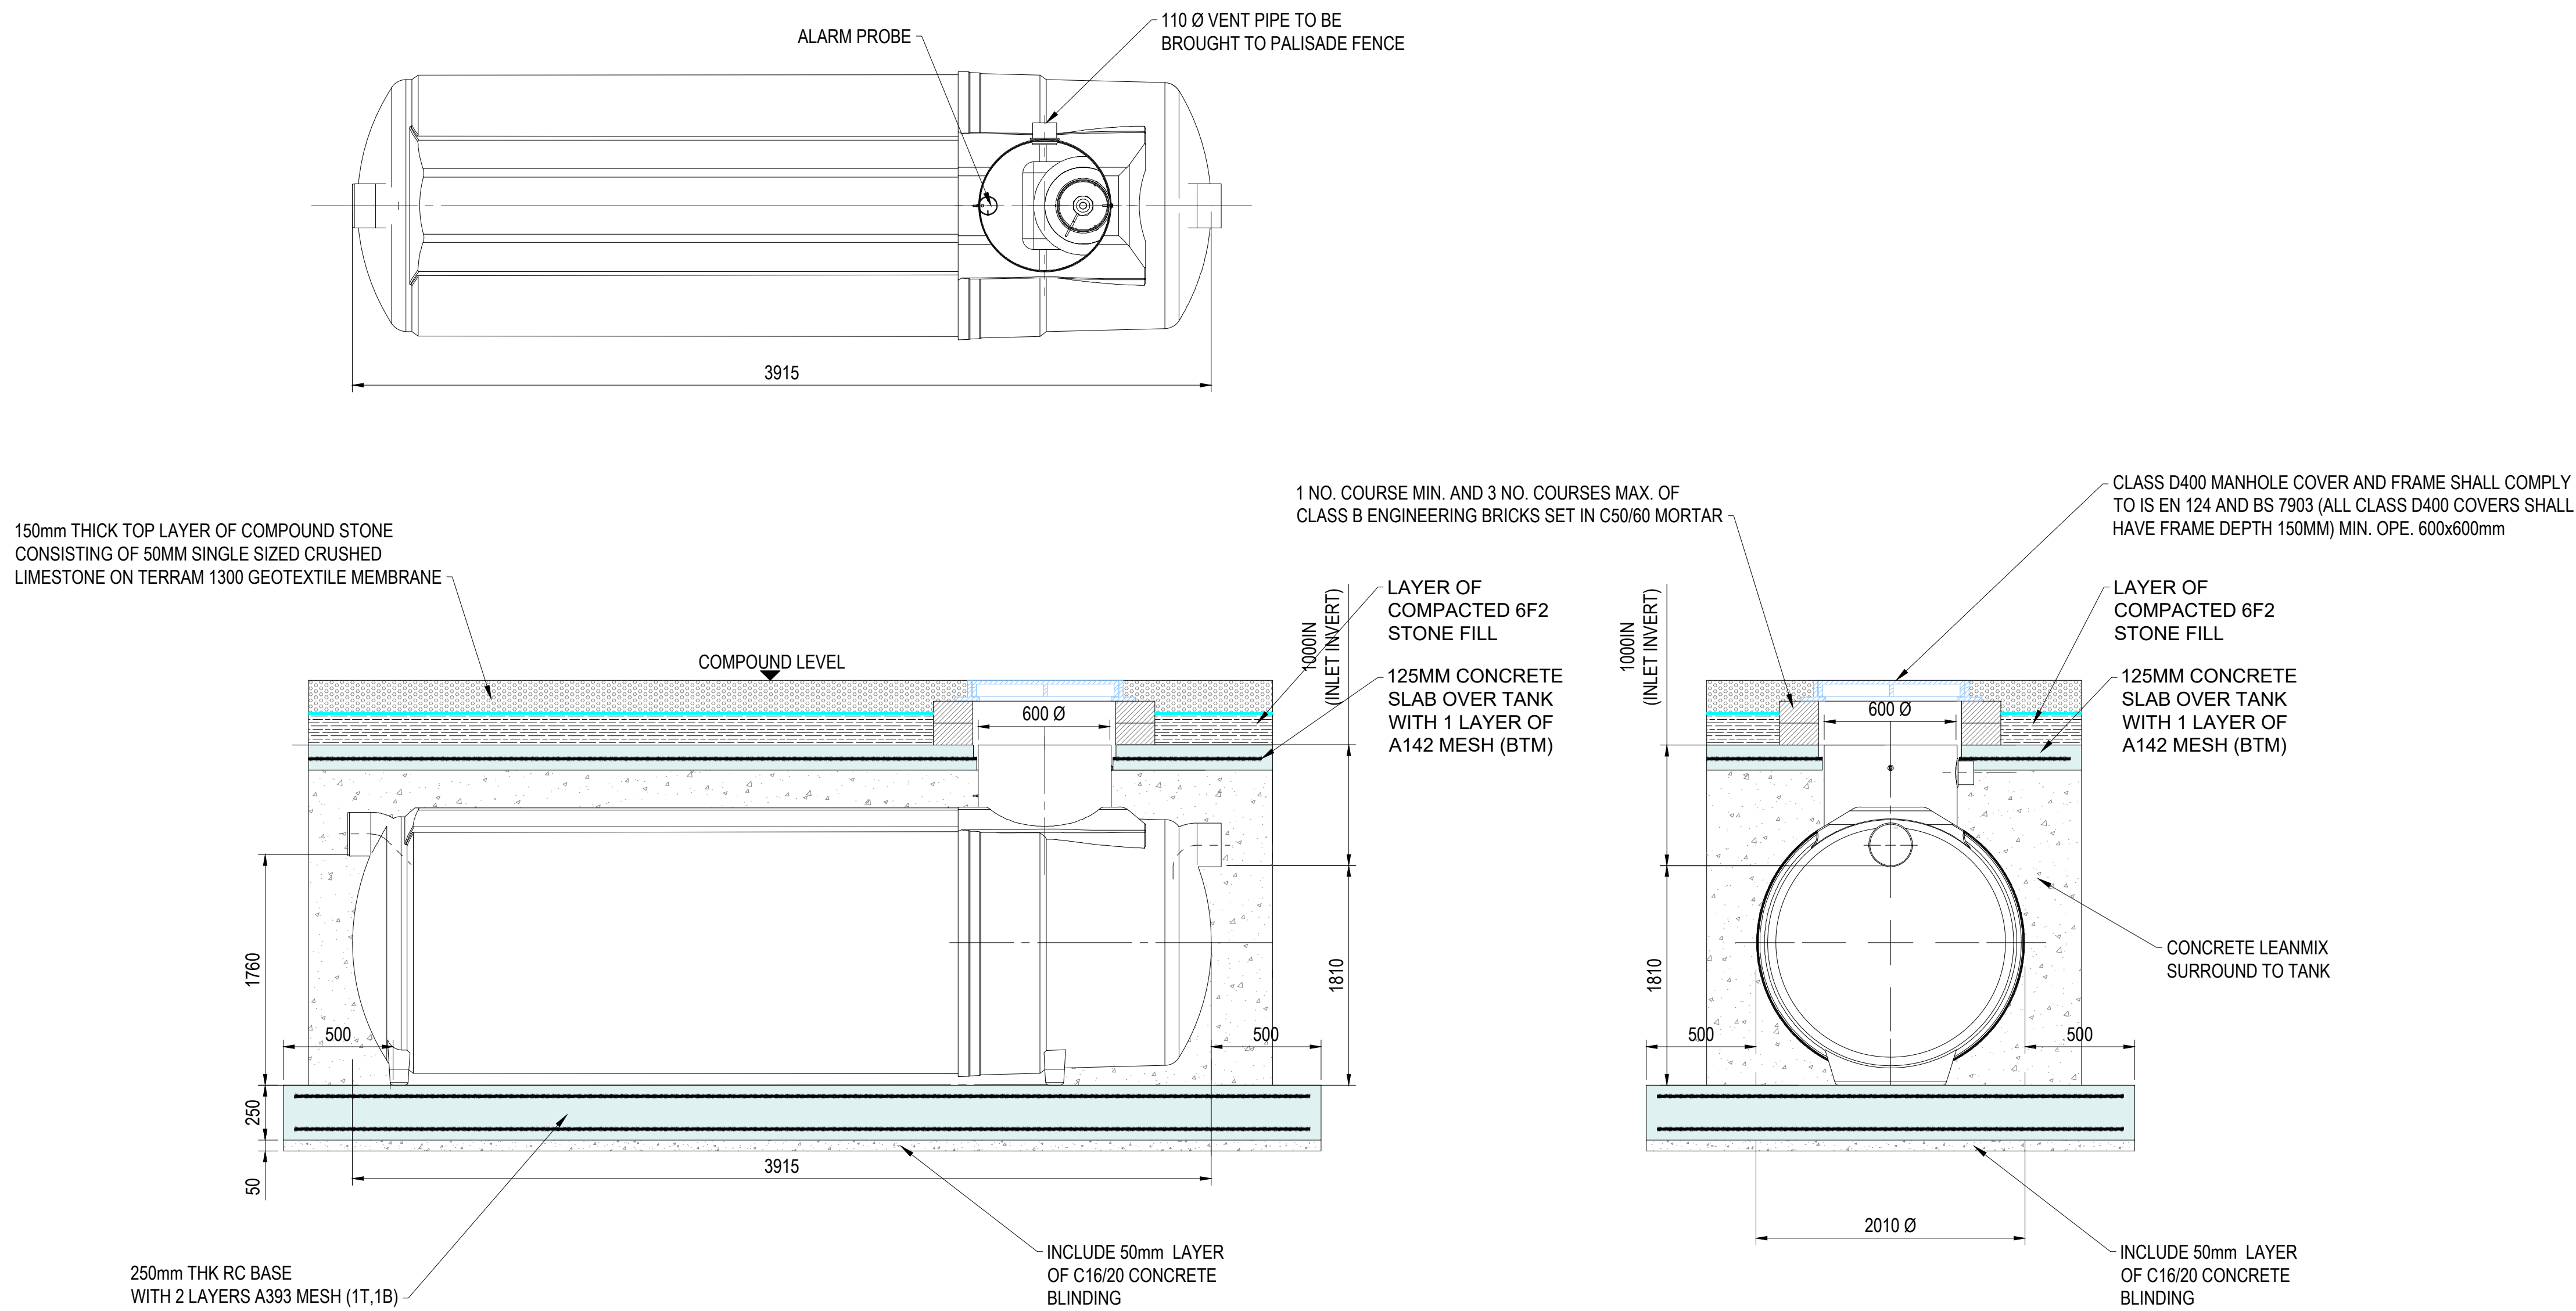

FULL RETENTION CLASS 1 INTERCEPTOR  
TO BE A NSFA030 FITTED WITH AN OIL FUEL ALARM AND AN ADAPTOR FOR THE LARGER  
DIAMETER 225MM PIPE. ALLOW FOR 50MM STANDARD DROP ACROSS THE INTERCEPTOR.

SCALE 1:20

P03 26-05-25	ISSUED FOR INFORMATION	SR	IB
P02 22-05-25	ISSUED FOR INFORMATION	SR	IB
P01 11-03-25	ISSUED FOR INFORMATION	SR	IB
REV	DATE	DESCRIPTION	BY APP

PROJECT:  
DREHID SUBSTATION

TITLE:  
PETROL INTERCEPTOR DETAILS

CLIENT:  
NORTH KILDARE WF LTD.



DRAWN: SR	CHECKED: CF	APPROVED: IB
PROJECT NUMBER: 23727	DATE: MAY 24	SCALE @ A1: 1:20
STATUS DESCRIPTION FOR INFORMATION		STATUS: S2

DRAWING NUMBER: 23727 - MWP -SS- ZZ- DR- C- 2401	REV: P03
-----------------------------------------------------	-------------