




STILLING POND LAYOUT
Scale 1:250

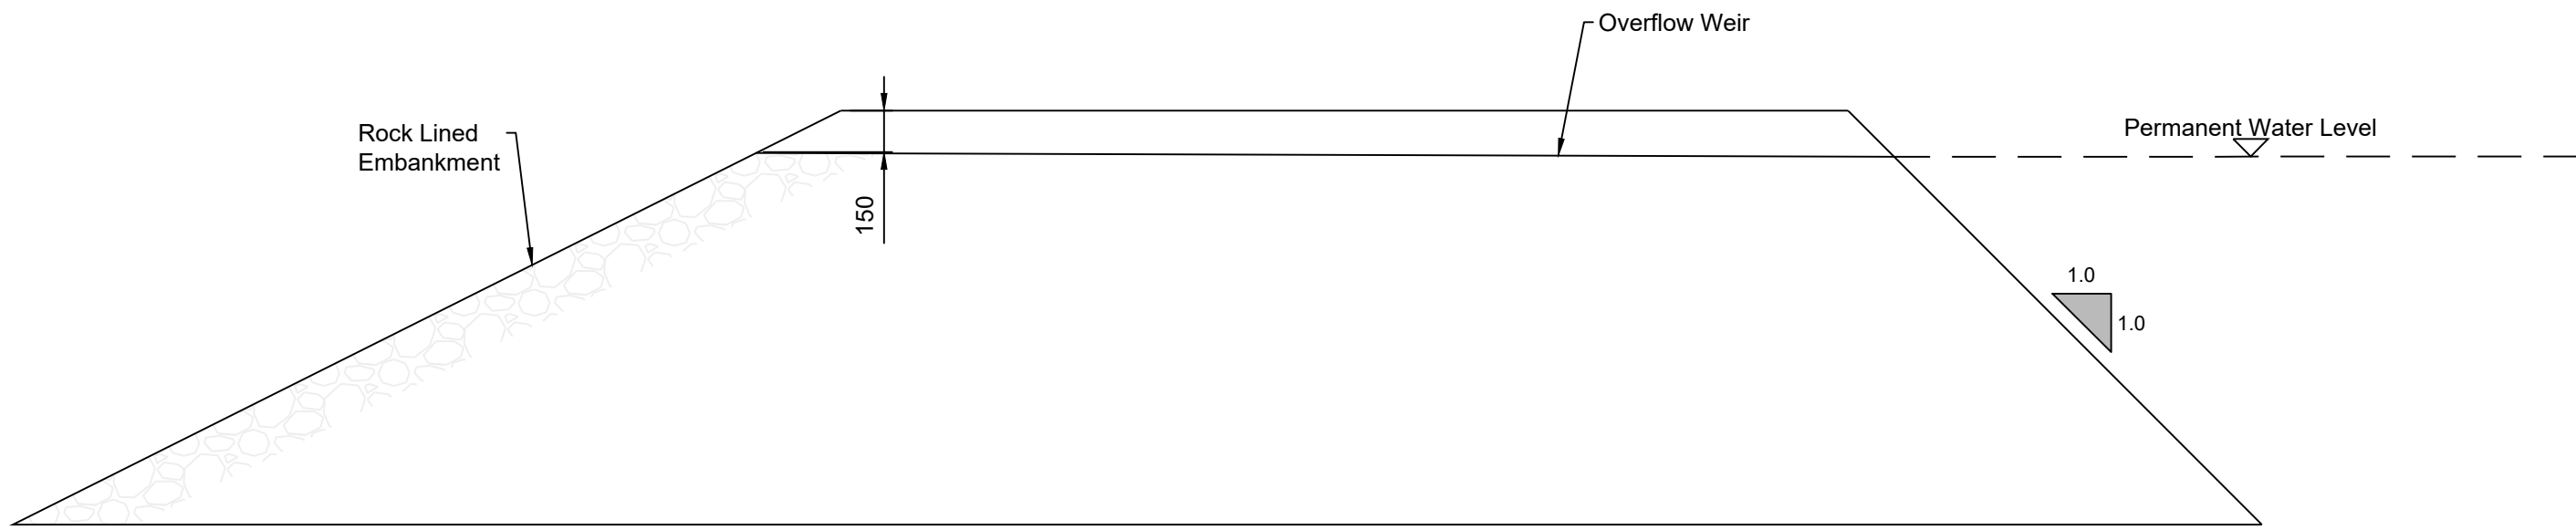

SECTION AT OUTLET
Scale 1:25

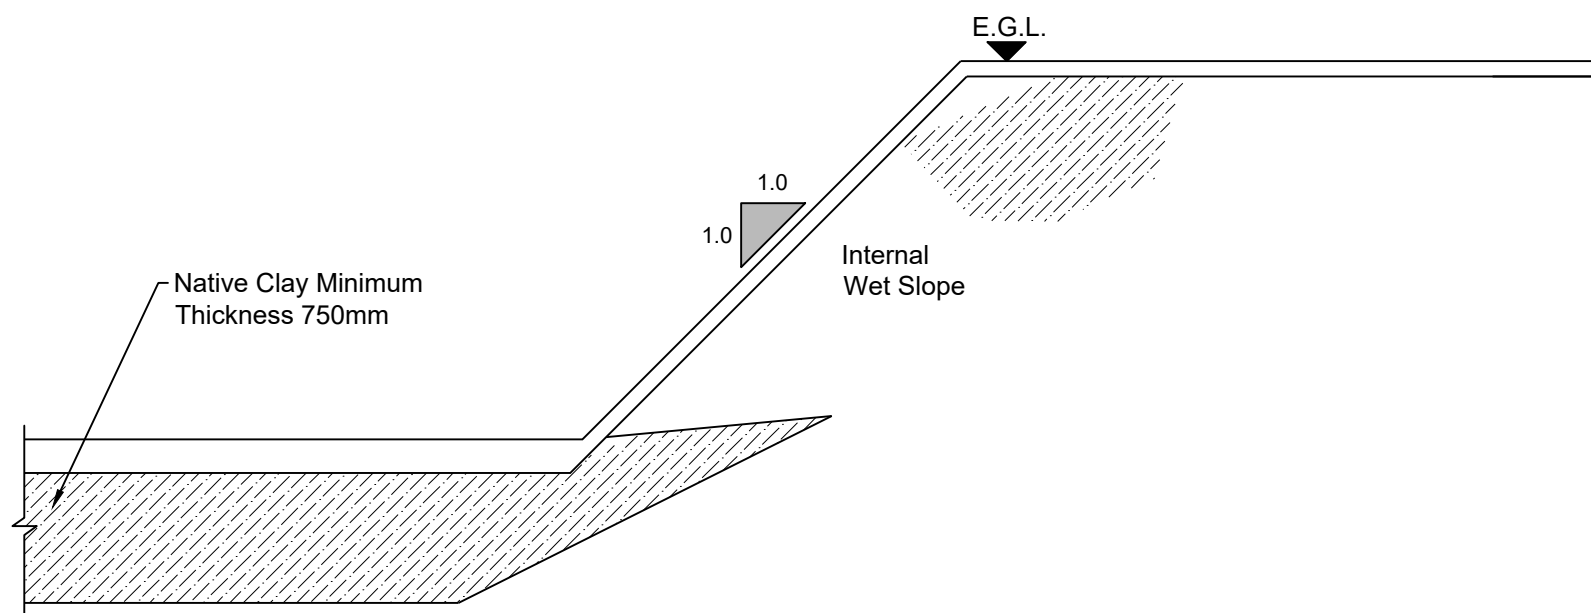

BUND CONSTRUCTION
(Where Pond is Below Ground Level)
Scale 1:25

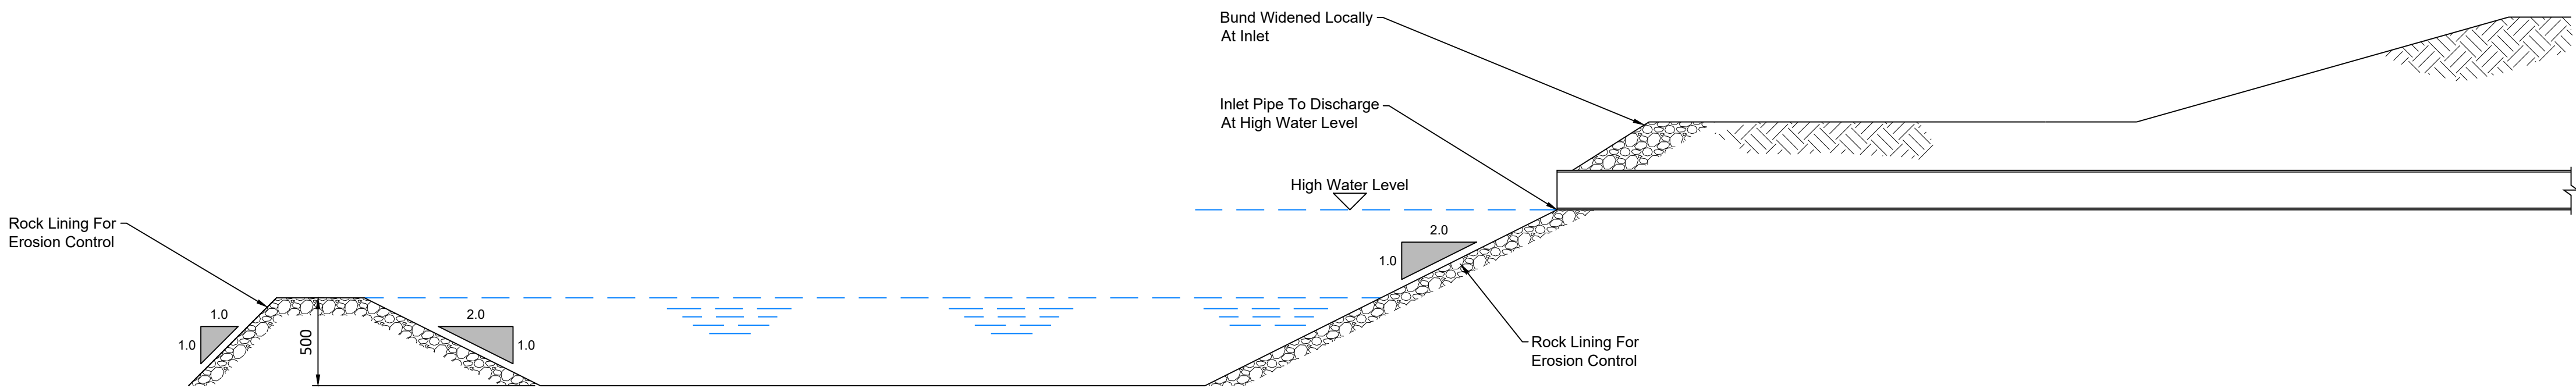

SECTION THROUGH FOREBAY
Scale 1:25

- NOTES**
1. This drawing should only be read in relation to subject of the title. Other information shown on drawing is to be considered indicative only.
 2. All dimensions are in millimetres unless otherwise stated.
 3. The pond base and sides below the permanent water level should be made impermeable by:
Cohesive material using native clay or a synthetic liner 1 mm LLDPE.
 4. Bunds in ponds to be constructed from native clay.
 5. Erosion control to be rock lining. Extent to be agreed on site.
 6. Rock lining to be a 125mm thickness of Class 1B material.
 7. Refer to stilling pond schedules for pond sizes.
 8. Swale inlet at 0.15 m below top of pond.
 9. All ponds to be fenced off.

If Applicable : Ordnance Survey Ireland Licence No. EN 0001218 © Ordnance Survey Ireland and Government of Ireland
OSI SHEETS 3122-C, 3122-D,3187-A,3187-B,3187-C,3187-D,3188-A,3188-B,3188-C,3188-D,3253-A,3253-B,3253-C,3253-D,

Rev.	Description	App By	Date
A	ISSUE FOR PLANNING	JH	19.05.25

PROJECT	CLIENT		
DREHID WIND FARM & SUBSTATION	NORTH KILDARE WIND FARM Ltd.		
SHEET	Date 19.05.25	Project number P22-242	Scale (@ A1-) As Shown
STILLING POND DETAILS	Drawn by CS	Drawing Number P22-242-0300-0030	Rev A
	Checked by BC		